


Keeler to Tillamook 115-kV Transmission Line Rebuild Project Outage Schedule

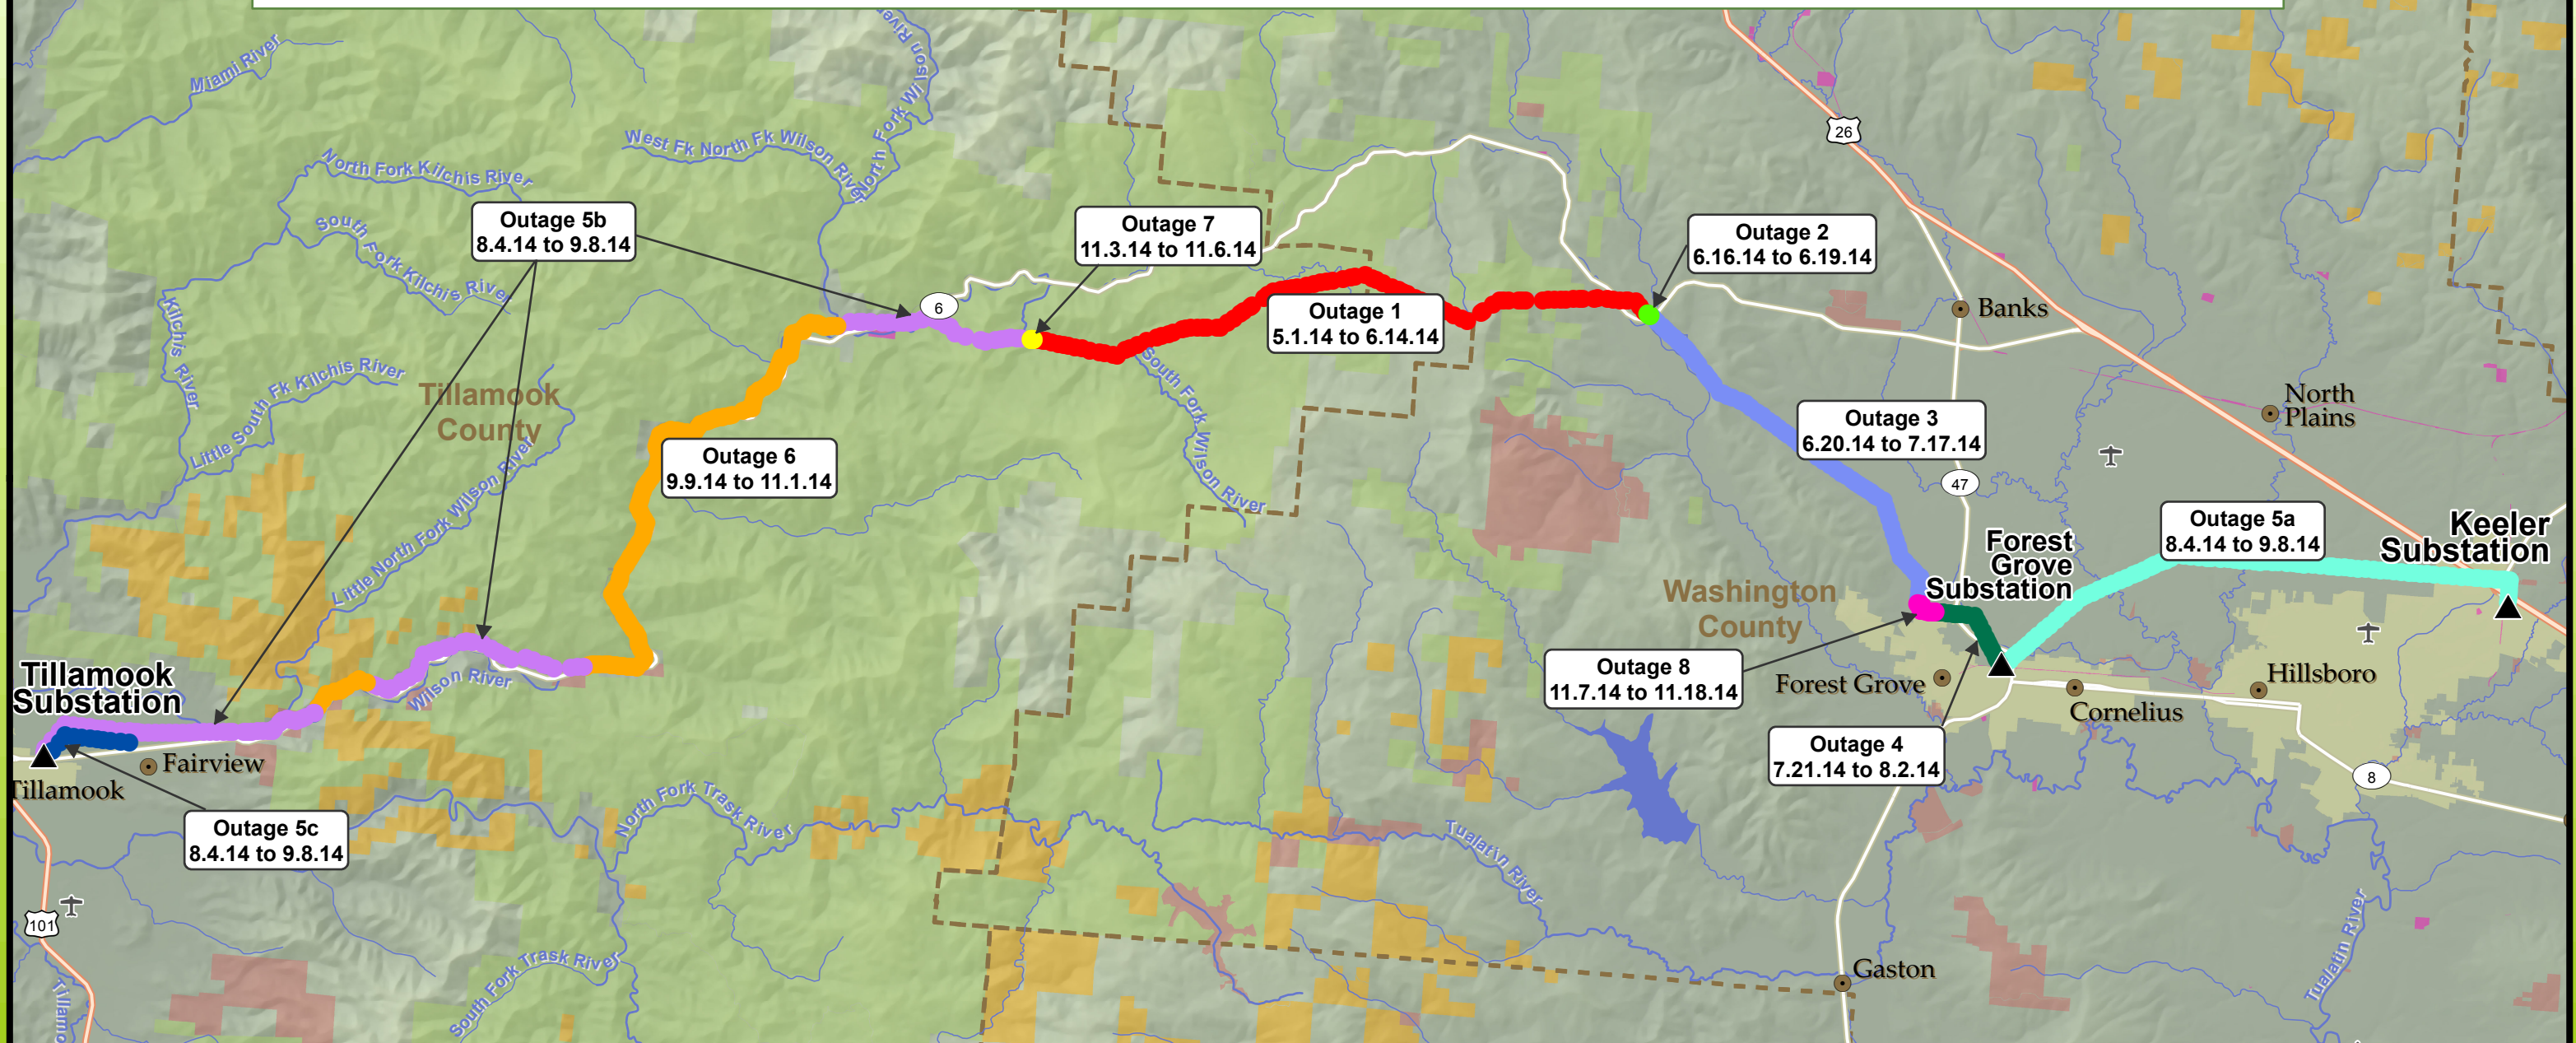

This product was made for informational and display purposes only and was created with best available data at time of production. It does not represent any legal information or boundaries. Source: BPA Regional GIS Database, 2012. Map Completion Date: December 11 2013

Outages

- Outage 1 -Timber Tap to South Fork - 45 Days
- Outage 2 -Thatcher to South Fork - 4 Days
- Outage 3 -Thatcher to Timber Tap - 28 Days
- Outage 4 - Forest Grove to Thatcher - 13 Days
- Outage 5a - Keeler to Forest Grove - 36 Days
- Outage 5b - South Fork to Tillamook - 36 Days
- Outage 5c - Carlton to Tillamook, hold order - 36 Days
- Outage 6 - South Fork to Tillamook - 54 Days
- Outage 7 - Timber Tap to Tillamook - 4 Days
- Outage 8 - Forest Grove to Timber Tap - 12 Days

- ▲ BPA Substation
- ✈ Public Airports
- ⋯ County Boundaries
- Urban Areas

Land Ownership

- BLM
- County or City
- Tillamook State Forest (ODL)
- Oregon Department of State Lands

